
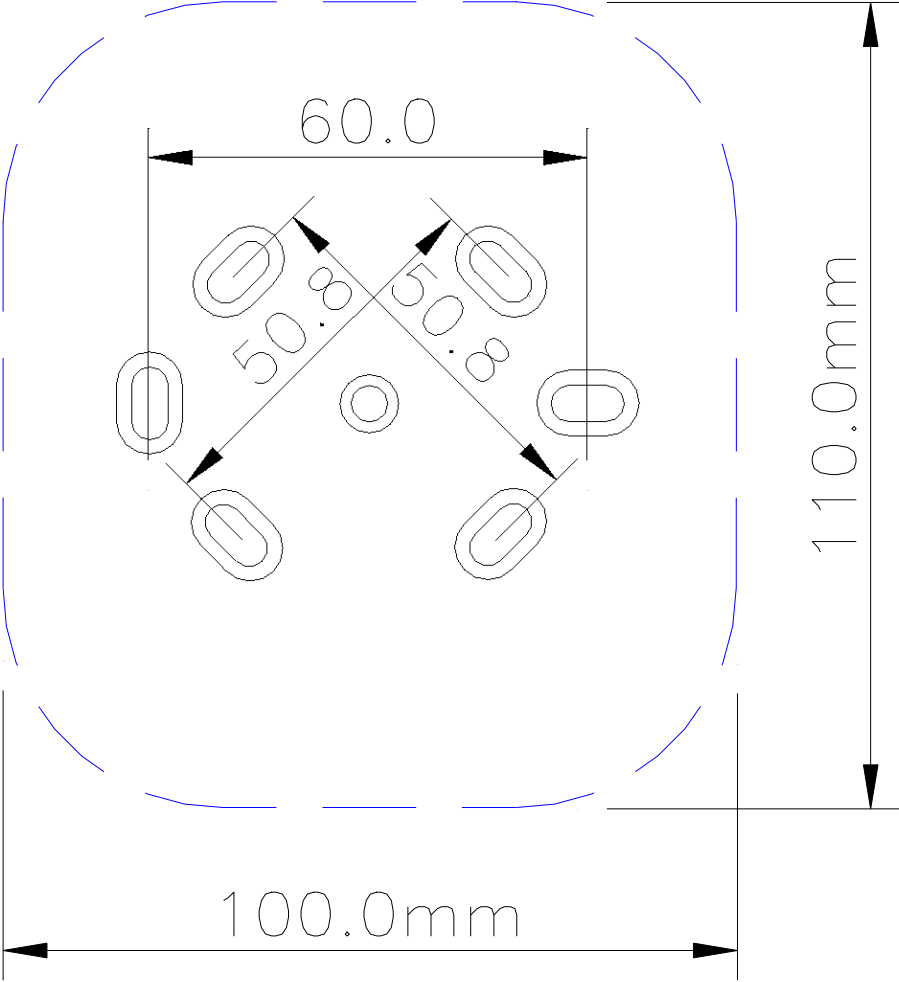
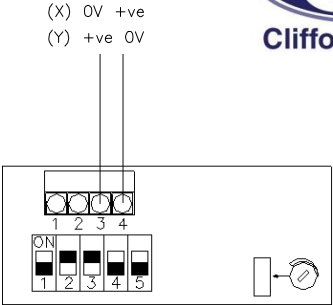


Polar Diagram of Tone 11

Tones marked * are approved to EN54-3.

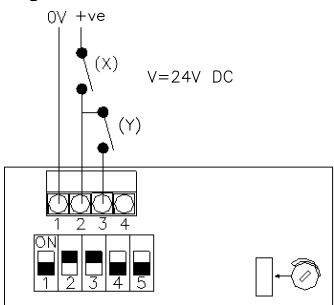

			(X)	(Y)
*	1	1000Hz 800Hz	0.5s	3
	2	3100Hz 2500Hz	0.5s	4
	3	1000Hz 800Hz	0.5s	7
	4	3100Hz 2500Hz	0.5s	8
*	5	554Hz 440Hz	0.1s 0.4s	14
	6	470Hz 430Hz	1s	14
	7	1000Hz 800Hz	0.5s	12
	8	3200Hz 2500Hz	0.5s	13
	9	554Hz 440Hz	1s	10
	10	700Hz		1

*	11		1000Hz		31
	12		1000Hz		7
	13		2300Hz		2
	14		440Hz		9
*	15		1000Hz		31
*	16		420Hz		30
	17		1000Hz		1
	18		2500Hz		4
	19		2500Hz		2
	20		700Hz		10
	21		1000Hz		32
	22		700Hz		10
	23		700Hz		10
	24		720Hz		10

	25		1400Hz		26
	26		1200Hz		11
	27		1000Hz		17
*	28		1000Hz		11
	29		1000Hz		32
*	30		1200Hz		12
*	31		2500Hz		11
	32		1200Hz		26

This is an audible alarm device for fire alarm devices on the standard EN 54-3 with EC-Certificate of conformity (Construction Products Regulations) 2797-CPR-713892 which was first issued at the year 2020.



Moflash Signalling Ltd

11, Upper Conybere Street
Highgate, Birmingham
B12 0EB, UK



Main Tel No: +44 (0) 121 440 5894
Sales Direct Tel No: +44 (0) 121 446 5322
Sales Fax No: +44 (0) 121 446 4344
E-mail: uksales@moflash.co.uk
E-mail: exportsales@moflash.co.uk
www.moflash.co.uk



FM 558977

S00628