



Flush-mount LCD multimeters.
expandable
DMG615
Three-phase + neutral

Product designation

Product type designation

Type

Auxiliary supply Us

Auxiliary rated supply voltage AC	VAC	100...440
Auxiliary rated supply voltage DC	VDC	120...250
Auxiliary operating voltage range		
AC	min	VAC 90
	Max	VAC 484
DC	min	VDC 93.5
	Max	VDC 300

Operational frequency

min	Hz	45
max	Hz	66

Power consumption

Max	VA	9.5
-----	----	-----

Power dissipation Max

W	3.5
---	-----

Measuring voltage inputs

Rated voltage (Ue)

phase-phase	VAC	600
phase-neutral	VAC	300

Operating voltage range

phase-phase	VAC	50...720
phase-neutral	VAC	30...360

Voltage inputs operational frequency

min	Hz	45
max	Hz	66

Voltage inputs measurement method

True RMS

Connection method

Single. two.
three-phase with
or without neutral.
balanced three-
phase system

Current inputs

Rated current (Ie)	A	1A/5A
Measurement range		0.025...6A
Measurement method		TRMS
Overload capacity		+20% Ie by external CT with 5A secondary
Overload peak	A	50A for 1s

Accuracy

VLN voltage	±0.2%
VLL voltage	±0.2%
Current	±0.2%
Frequency	±0.05%
Active power	±0.5%
Active energy	Class 0.5s (IEC/EN 62053-22)
Reactive energy	Class 2 (IEC/EN 62053-23)

Insulations

Rated insulation voltage Ui IEC/EN	V	600
Rated impulse withstand voltage Uimp	kV	9.5
Operating frequency withstand voltage	kV	5.2

Functions

Harmonic analysis	15th order
PLC logic	No
Type of communication port	RS485
Ethernet-RS485 gateway function	No

Mechanical features

Housing type	Polyamide
Terminals type	Removable
Conductor cross section	

min	mm ²	0.2
Max	mm ²	2.5
min	AWG	24
Max	AWG	12

Tightening torque (Max)

Nm	0.5
lbin	4.5

Fixing	Flush-mounting
Weight	g 350

Ambient conditions

Temperature

Operating temperature


min	°C	-20
max	°C	+60

Storage temperature

min	°C	-30
max	°C	+80


Relative humidity	%	<90
Maximum Pollution degree		2
Protection degree		IP40 on front - IP20 terminals

Dimensions

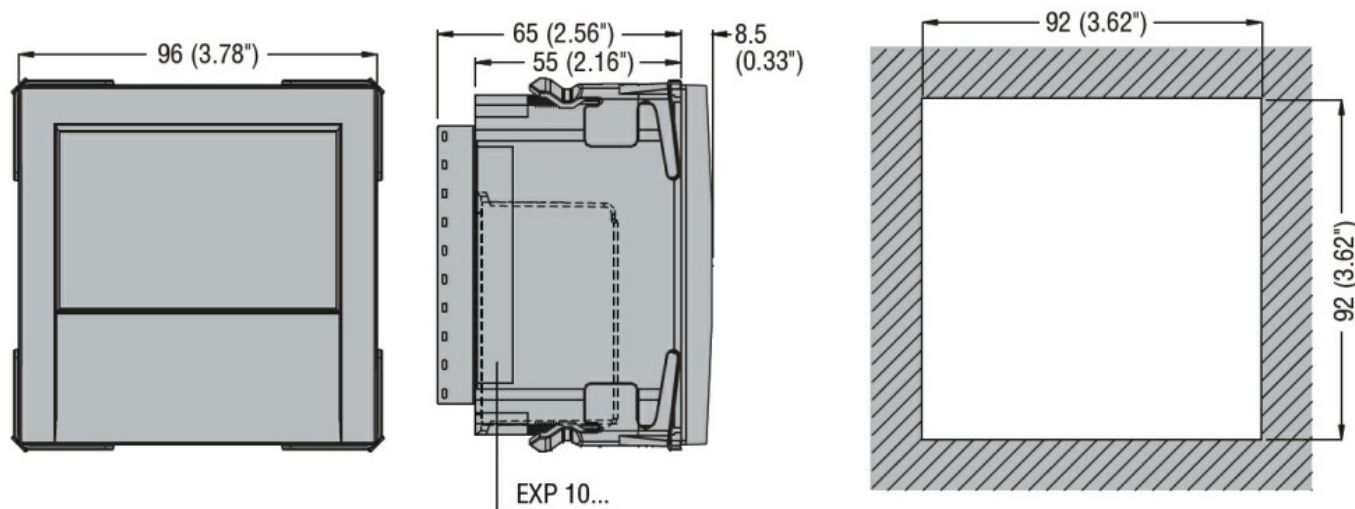


Wiring diagrams


3-phase connection with or without neutral
P01.07 = L1-L2-L3-N L1-L2-L3

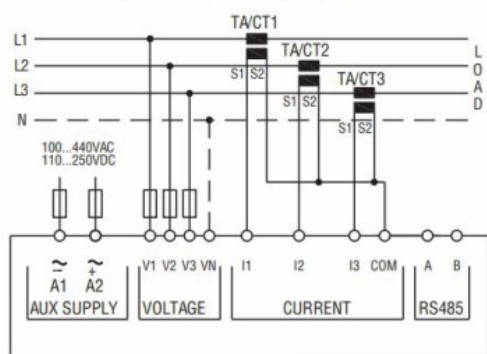


2-phase connection
P01.07 = L1-N-L2

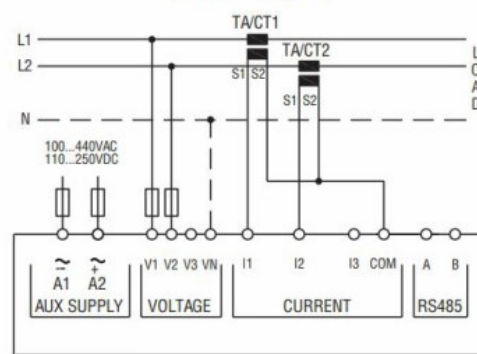

Single-phase connection
P01.07 = L1-N

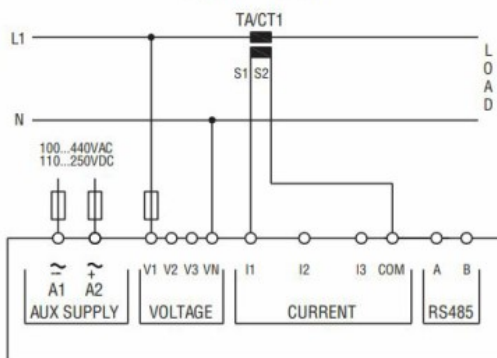

Balanced 3-phase connection with or without neutral
P01.07 = L1-L2-L3-N-BIL L1-L2-L3-BIL

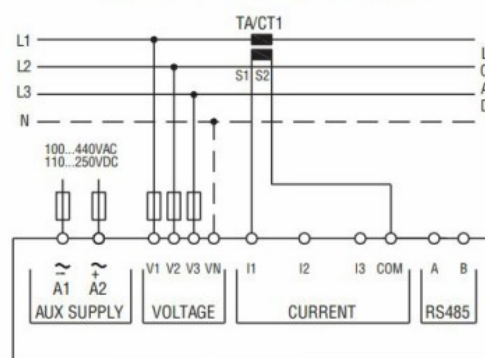

Certifications and compliance

Compliance

IEC/EN 61000-6-2
IEC/EN 61000-6-3
IEC/EN 61010-1
IEC/EN 61010-2-030

Certificates

cULus

ETIM classification

ETIM 8.0

EC002301 -
Multifunction
measuring
instrument