



Voltage monitoring relays for 3-phase systems without neutral




Phase loss and incorrect phase sequence (PMV10-PMV20-PMV30-PMV40-PMV50-PMV70)

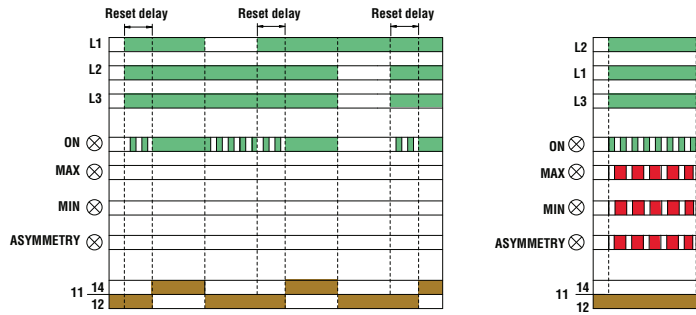

PMV10 - PMV20 - PMV30 PMV40 - PMV50 - PMV70

Maximum and minimum voltage (PMV30 - PMV50 - PMV70)

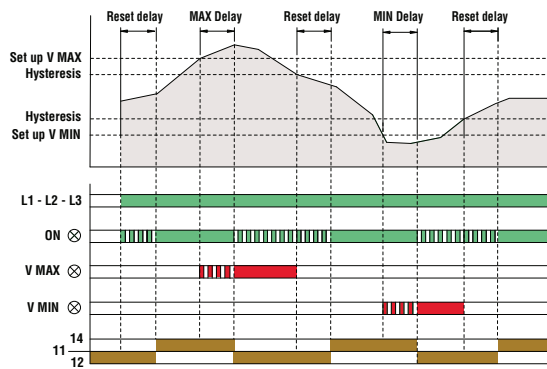

Asymmetry (PMV40 - PMV70)

